



02 9700 9996  
glenco.com.au  
service@glenco.com.au



## Platinum Business Park, Alexandria NSW

### The Brief

Platinum Business Park in Alexandria required a complete upgrade to the underground submain cabling to the electrical distribution board. This was required after a fault was found on existing submain cabling.



ELECTRICAL



AIRCON



BUILDING &  
MAINTENANCE



SECURITY



ENERGY



FIRE



COMMS



LEVEL 2




24  
HRS




# The Delivery

The Glenco team located the existing services to ensure that no other services were disrupted during this work. The existing concrete driveway was saw cut, broken up and removed for trenches to be dug for the new conduit to be laid. A depth of 600mm trenching was dug out, 80 metres of 250mm conduit was laid, along with the installation of 3 new electrical pits. Brand new cable was installed into the conduit, trenches re filled, compacted and set with new concrete.

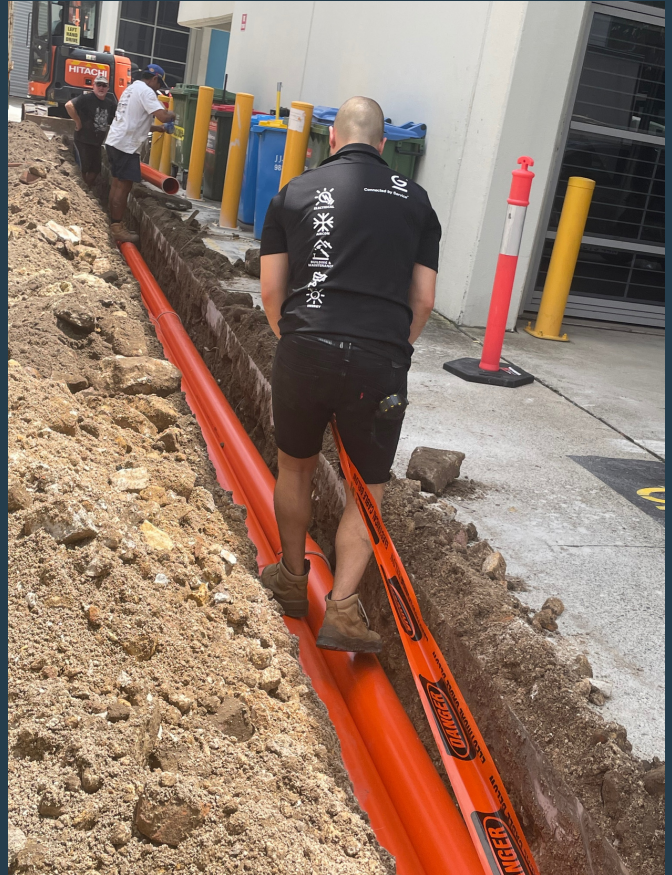

# The Outcome

Successfully delivering this complex with an upgrade of its electrical services to now maintain the load requirements for all 46 Units. Completing this work in a short time frame so there was little disruption to the working hours of the businesses within the commercial business park.

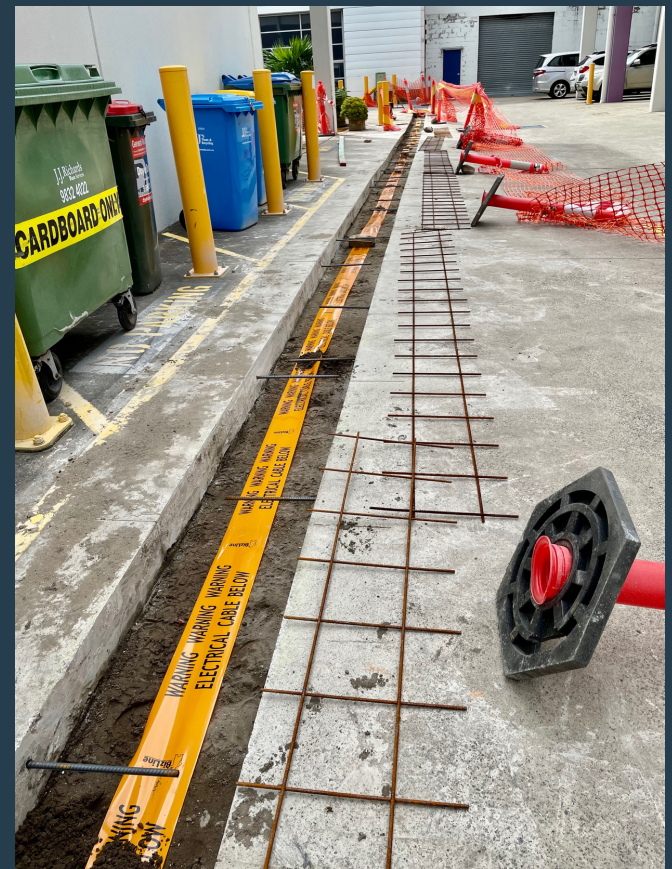

ELECTRICAL



AIRCON



BUILDING & MAINTENANCE



SECURITY



ENERGY



FIRE



COMMS



LEVEL 2

